





No.DJB/QCLTYR/PD/250907

DELHI JAL BOARD
(GOVT. OF N.C.T. DELHI)
QUALITY CONTROL LABORATORY,
TRANS YAMUNA REGION TAHIRPUR DELHI-110093

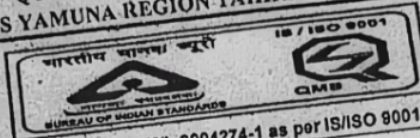

Licence No- CRO/QM/L-8004274-1 as per IS/ISO 9001:2015



DATE:- 24-09-2025

NO: DJB/ACWA(TYR)/2025.....

Analysis report of DJB water supply samples collected from (1) Inlet, (2) Outlet (Near Sr. Secondary wing) of M/S GREENFIELDS PUBLIC SCHOOL, DILSHAD GARDEN, GTB ENCLAVE, DELHI-110093 for drinking purpose.

Ref. No. GPS/DG/DJB/1215,
Challan No: - 151,

dated: - 05.08.2025
dated: - 17.09.2025

ACWA-TYR

Diary No. 601 dt. 27.09.25

S. No.	PARTICULARS	BIS:10500-2012 LIMITS		UNITS	RESULT	
		Desirable	Permissible		(1)	(2)
A.	Physical Examination	...	...	-	CLEAR	CLEAR
1.	Colour	...	...	-	CHLOR.	CHLOR.
2.	Odour	1.0	5.0	NTU	4.23	3.42
3.	Turbidity	6.5-8.5	-	-	7.4	7.4
4.	pH Value	-	-	µs/cm	345	353
5.	Electrical Conductivity	-	-	mg/l	224	229
6.	Total Dissolved Solids	500	2000	mg/l	NIL	NIL
B.	Chemical Examination	...	...	mg/l	98	98
7.	p th Alkalinity	200	600	mg/l	132	132
8.	Total Alkalinity	200	600	mg/l	33.6	33.6
9.	Total Hardness	75	200	mg/l	11.52	11.52
10.	Calcium as (Ca)	30	100	mg/l	N.D	N.D
11.	Magnesium as (Mg)	0.5	NR	mg/l	N.D	N.D
12.	Ammonical Nitrogen	...	...	mg/l	3.85	4.65
13.	Nitrite	45	NR	mg/l	32.95	33.92
14.	Nitrate	200	400	mg/l	24	24
15.	Sulphate	250	1000	mg/l	0.09	N.D
16.	Chloride	1.0	1.5	mg/l	0.08	0.08
17.	Fluoride	1.0	NR	mg/l	N.D	N.D
18.	Dissolved Iron	0.05	NR	mg/l	0.80	0.65
19.	Cyanide	0.2	1.0	mg/l	0	0
20.	Residual Chlorine			MPN/100ml	0	0
C.	Bacteriological Examination	Absent	NR			
21.	Coliform count					

REMARKS:- On the basis of above tested parameters, both water samples conform BIS: 10500-2012 and can be considered fit for drinking purpose.

(Purushottam Singh)
ACWA(TYR)

Asstt. Chief Water Analyst
D.J.B. Govt. of N.C.T. of Delhi
Quality Control Zonal Laboratory (TYR)
Tahir Pur Dilshad Garden, Delhi-93

(A.G. Susmitha)
BACTERIOLOGIST

(Gulsh Jaiswal)
CHEMIST

(Mayank Yadav)
A/CHEMIST